

Control # 050020110817

Date Taken 08/17/2011

Service Meter Reading 0

Fluid Run Time 0

Fluid Added Gal / Qts 0 / 0

Fluid Status Sampled

Filter Changed Unknown

BS&W % Volume 0.1000

API Gravity@60 36.7

IBP ASTM D86 F 334

10% Point F 392

50% Point F 490

90% Point F 582

End Point F 630

% Residue 1.6

Cetane 47.2

Bacteria Positive 3

Thermal Stability 97%



**Lab One Inc.**

Oil Analysis since 1985

Mail to: PO Box 20210 - Phoenix, AZ 85036-0210

Ship to: 101 W Mohave St. - Phoenix AZ 85003

Phone

Local: 480-839-5221

Toll Free: 866-652-2663

Fax: 480-839-9987

**Critical**

1 of 1

07/01/2014

**Make / Model**

**Unit/Serial**

DIESEL FUEL/

**Compartment**

Diesel Fuel

**Fluid Type**


**WO / Reference**

**Current Interpretation**

BS&W results above ASTM specifications. Recommend check for source of contamination. Bacteria results positive, level 3 of 5 contamination. Bacteria Count/mL @ 1:10 dilution = 100,000. Recommend perform appropriate bacteria/algae removal technologies.

0000000084

Lab One Web Test  
Attn: Jason Kronlund  
101 West Mohave Street  
Phoenix, AZ 85003

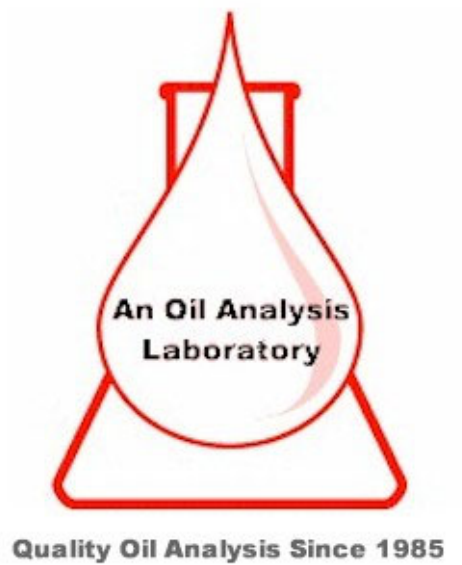

Registered By: **JASON KRONLUND**

Interpreted By: **JASON KRONLUND**

For additional sample history visit us at [www.LabOneInc.com](http://www.LabOneInc.com)